

Environment Fact Sheets

Source water quality, 2013

by Environment, Energy and Transportation Statistics Division

Release date: December 18, 2015



How to obtain more information

For information about this product or the wide range of services and data available from Statistics Canada, visit our website, www.statcan.gc.ca.

You can also contact us by

Email at STATCAN.infostats-infostats.STATCAN@canada.ca

Telephone, from Monday to Friday, 8:30 a.m. to 4:30 p.m., at the following toll-free numbers:

- Statistical Information Service 1-800-263-1136
- National telecommunications device for the hearing impaired 1-800-363-7629
- Fax line 1-877-287-4369

Depository Services Program

- Inquiries line 1-800-635-7943
- Fax line 1-800-565-7757

Standards of service to the public

Statistics Canada is committed to serving its clients in a prompt, reliable and courteous manner. To this end, Statistics Canada has developed standards of service that its employees observe. To obtain a copy of these service standards, please contact Statistics Canada toll-free at 1-800-263-1136. The service standards are also published on www.statcan.gc.ca under “Contact us” > “Standards of service to the public.”

Note of appreciation

Canada owes the success of its statistical system to a long-standing partnership between Statistics Canada, the citizens of Canada, its businesses, governments and other institutions. Accurate and timely statistical information could not be produced without their continued co-operation and goodwill.

Standard table symbols

The following symbols are used in Statistics Canada publications:

- . not available for any reference period
- .. not available for a specific reference period
- ... not applicable
- 0 true zero or a value rounded to zero
- 0^s value rounded to 0 (zero) where there is a meaningful distinction between true zero and the value that was rounded
- ^P preliminary
- ^r revised
- X suppressed to meet the confidentiality requirements of the *Statistics Act*
- ^E use with caution
- F too unreliable to be published
- * significantly different from reference category ($p < 0.05$)

Published by authority of the Minister responsible for Statistics Canada

© Minister of Industry, 2015

All rights reserved. Use of this publication is governed by the Statistics Canada [Open Licence Agreement](#).

An HTML version is also available.

Cette publication est aussi disponible en français.

Source water quality, 2013

by Environment, Energy and Transportation Statistics Division

In 2013, drinking water plants in Canada produced 4,457 million cubic metres of potable water from surface water sources. Overall, nearly three quarters of the Canadian population received drinking water from plants using surface water sources such as rivers, lakes and reservoirs.

Water quality monitoring of the raw source water is performed by drinking water plant operations to assess the water quality and to ensure appropriate treatments for drinking water. It also helps establish trends in order to characterize changing water quality and ecosystem conditions at the source water site.

Escherichia coli (*E. Coli*) colonies in surface water sources (median monthly values)

The presence of *Escherichia coli* in source water is an indicator of recent faecal contamination and indicates an increased potential for the presence of other microbial pathogens that have the potential to cause disease or illness.¹

Elimination of *E. coli* is the objective of the primary disinfection processes applied at treatment plants. Secondary disinfection processes are also applied to maintain a disinfectant “residual” throughout the distribution system to avoid recontamination before water reaches the final user. Chlorination, which can be used for both primary and secondary disinfection, was applied to 96% of the surface water processed by drinking water plants in 2013. Ultraviolet irradiation and ozonation, which are effective for primary disinfection only, were applied to 22% and 25% of treated surface water respectively.

Seasonal changes of *E. coli* colonies in raw surface water sources are shown in Chart 1. The data indicates levels peak towards the fall with 2013 levels highest in September and in October during 2011.


1. (Health Canada, 2012, Guidelines for Canadian Drinking Water Quality, Guideline Technical Document, *Escherichia coli*, Federal-Provincial-Territorial Committee on Drinking Water http://www.hc-sc.gc.ca/ewh-semt/pubs/water-eau/escherichia_coli/index-eng.php (accessed July 24, 2015).

Source water quality, 2013

Chart 1

Median values of monthly quantity of *Escherichia coli* in raw surface water sources, MPN/100mL or CFU/100mL, 2011 and 2013

colonies per 100 mL

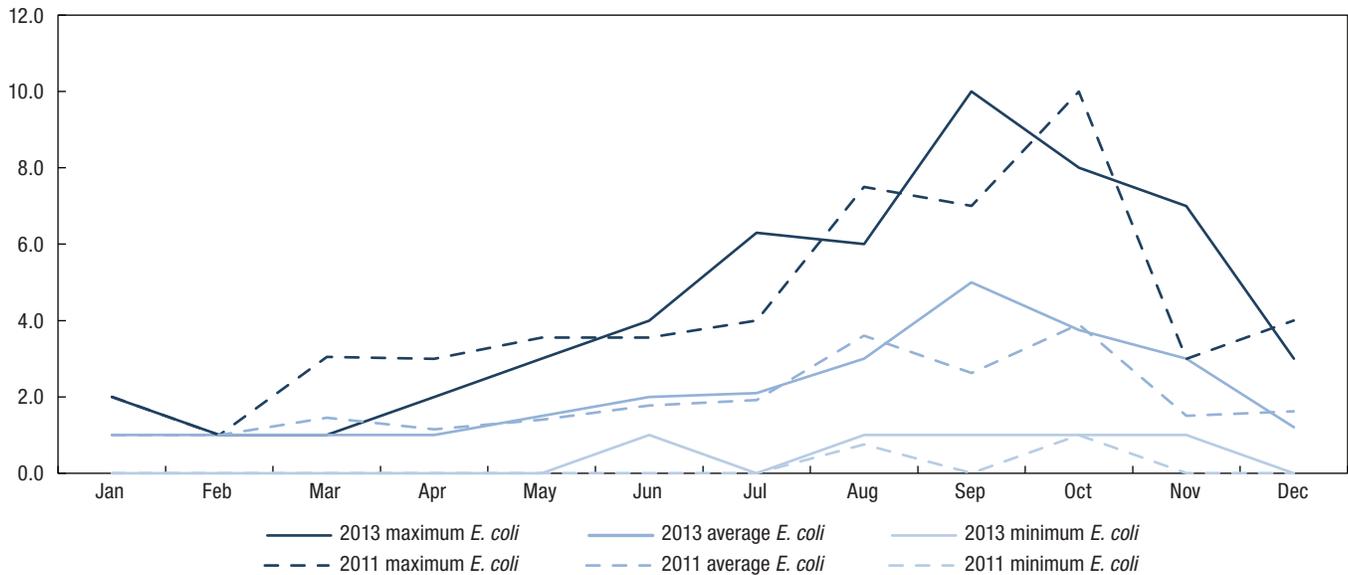

Note: The data in Chart 1 are from facilities that reported *E. coli* data for at least 10 months in both 2011 and 2013. These facilities serving 18 million people produced 3,049 Mm³ of potable water from surface water sources in 2013. *E. coli* in source water was monitored at least daily at 2% of these drinking water plants in 2013, was monitored at least weekly at 68% of plants and was less frequent at the rest.

Source: Statistics Canada, 2015, Environment, Energy and Transportation Statistics Division, Survey of Drinking Water Plants (survey number 5149).

Source water quality – Measuring total coliforms and *Escherichia coli* (*E. coli*)

Two methods routinely used to quantify *E. coli* organisms in water are membrane filtration, which measures colony forming units (CFUs) per 100 millilitres (mL) and multiple tube fermentation, which measures the most probable number (MPN) per 100 mL. Since survey respondents did not use the same method when analysing source water quality, both quantitative test methods are pooled together in Chart 1. According to *Standard Methods for the Examination of Water and Wastewater*, the membrane filter test is more precise; however data from each test yield approximately the same water quality information.²

Turbidity of surface water sources (median monthly values)

Turbidity refers to the relative cloudiness of water which is caused by suspended particles in the water and is measured as nephelometric turbidity units (NTU) by the scattering and absorbing effect that suspended particles have on light. Turbidity tends to be highest during spring runoff and can be attributed to inorganic silts, metallic precipitates as well as organic plant or animal debris and microorganisms in the water.³

Source water turbidity data are used by treatment plant operators to identify changing source water conditions that may increase challenges to filtration and disinfection. These data establish historic trends concerning source water conditions and are used to ensure the appropriate design and operation of the treatment plant.⁴

Chart 2 shows monthly turbidity levels of source water in Canada for 2011 and 2013. In both years median monthly turbidity peaked in the spring (May) and was higher in 2011 than in 2013.


2. American Public Health Association, American Water Works Association, Water Environment Federation, 2012, *Standard Methods for the Examination of Water and Wastewater*, 22nd Edition.

3. (Brown, S., L.M. Lavkulich, H. Schreier. 2011. "Developing Indicators for Regional Water Quality Assessment: An example from British Columbia Community Watersheds". *Canadian Water Resources Journal*, 36 (3): 271-284.)

4. Health Canada, 2012, *Guidelines for Canadian Drinking Water Quality, Guideline Technical Document, Turbidity*, Federal-Provincial-Territorial Committee on Drinking Water, <http://www.hc-sc.gc.ca/ewh-semt/pubs/water-eau/turbidity/index-eng.php> (accessed July 24, 2015).

Source water quality, 2013

Chart 2
Median values of monthly turbidity of raw surface water sources, 2011 and 2013

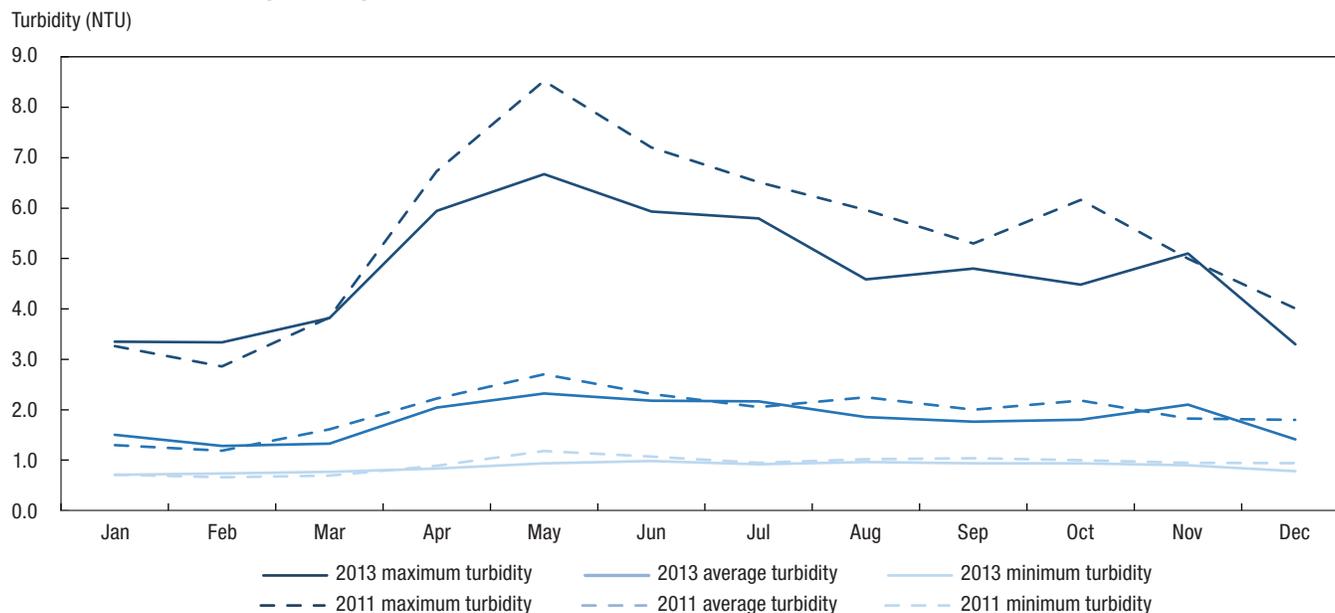

Note: The data in Chart 2 are from facilities that reported turbidity data for at least 10 months in both 2011 and 2013. These facilities serving 22 million people produced 3,743 Mm³ of potable water from surface water sources in 2013. Source water turbidity was monitored continuously at 43% of these drinking water plants in 2013, was monitored at least daily at 36% of plants and was less frequent at the rest.

Source: Statistics Canada, 2015, Environment, Energy and Transportation Statistics Division, Survey of Drinking Water Plants (survey number 5149).

Map 1 presents the 2013 median values of monthly maximum turbidity for raw surface water sources by drainage region from plants that reported data for at least 10 months of the year. The turbidity of source water tended to be highest in Western-Central Canada and the St. Lawrence drainage region and lowest on the West and East Coasts. Surface water sources in the Assiniboine–Red (12), the North Saskatchewan (10), Lower Saskatchewan–Nelson (14) and the St. Lawrence (21) drainage regions had the highest median maximum turbidity, in the range of 7.0 to 21.0 NTU in 2013. Results were similar for 2011.⁵

Treatment of surface water sources


In 2013 nearly two thirds (63%) of the surface source water was disinfected and treated by conventional and direct filtration plants. Conventional filtration processes include coagulation, flocculation, sedimentation and granular filtration. Direct filtration processes are similar but exclude sedimentation processes and are typically limited to source water with turbidity below 15 NTU.⁶ Membrane filtration systems treated 10% of the surface water and 14% was treated by other filtration systems. Drinking water plants using unfiltered systems that disinfect only, or disinfect and use other non-filtration processes, treated the remaining 13% of surface water.

5. Statistics Canada. (2013) Survey of drinking water plants, 2011. Statistics Canada, Minister of Industry, Ottawa, Ontario. Available at: <http://www.statcan.gc.ca/pub/16-403-x/16-403-x2013001-eng.htm>.

6. Health Canada, 2012, Guidelines for Canadian Drinking Water Quality, Guideline Technical Document, Turbidity, Federal-Provincial-Territorial Committee on Drinking Water, <http://www.hc-sc.gc.ca/ewh-semt/pubs/water-eau/turbidity/index-eng.php> (accessed July 24, 2015).

Source water quality, 2013

Map 1
Median values of monthly maximum turbidity of raw surface water sources by drainage region, 2013

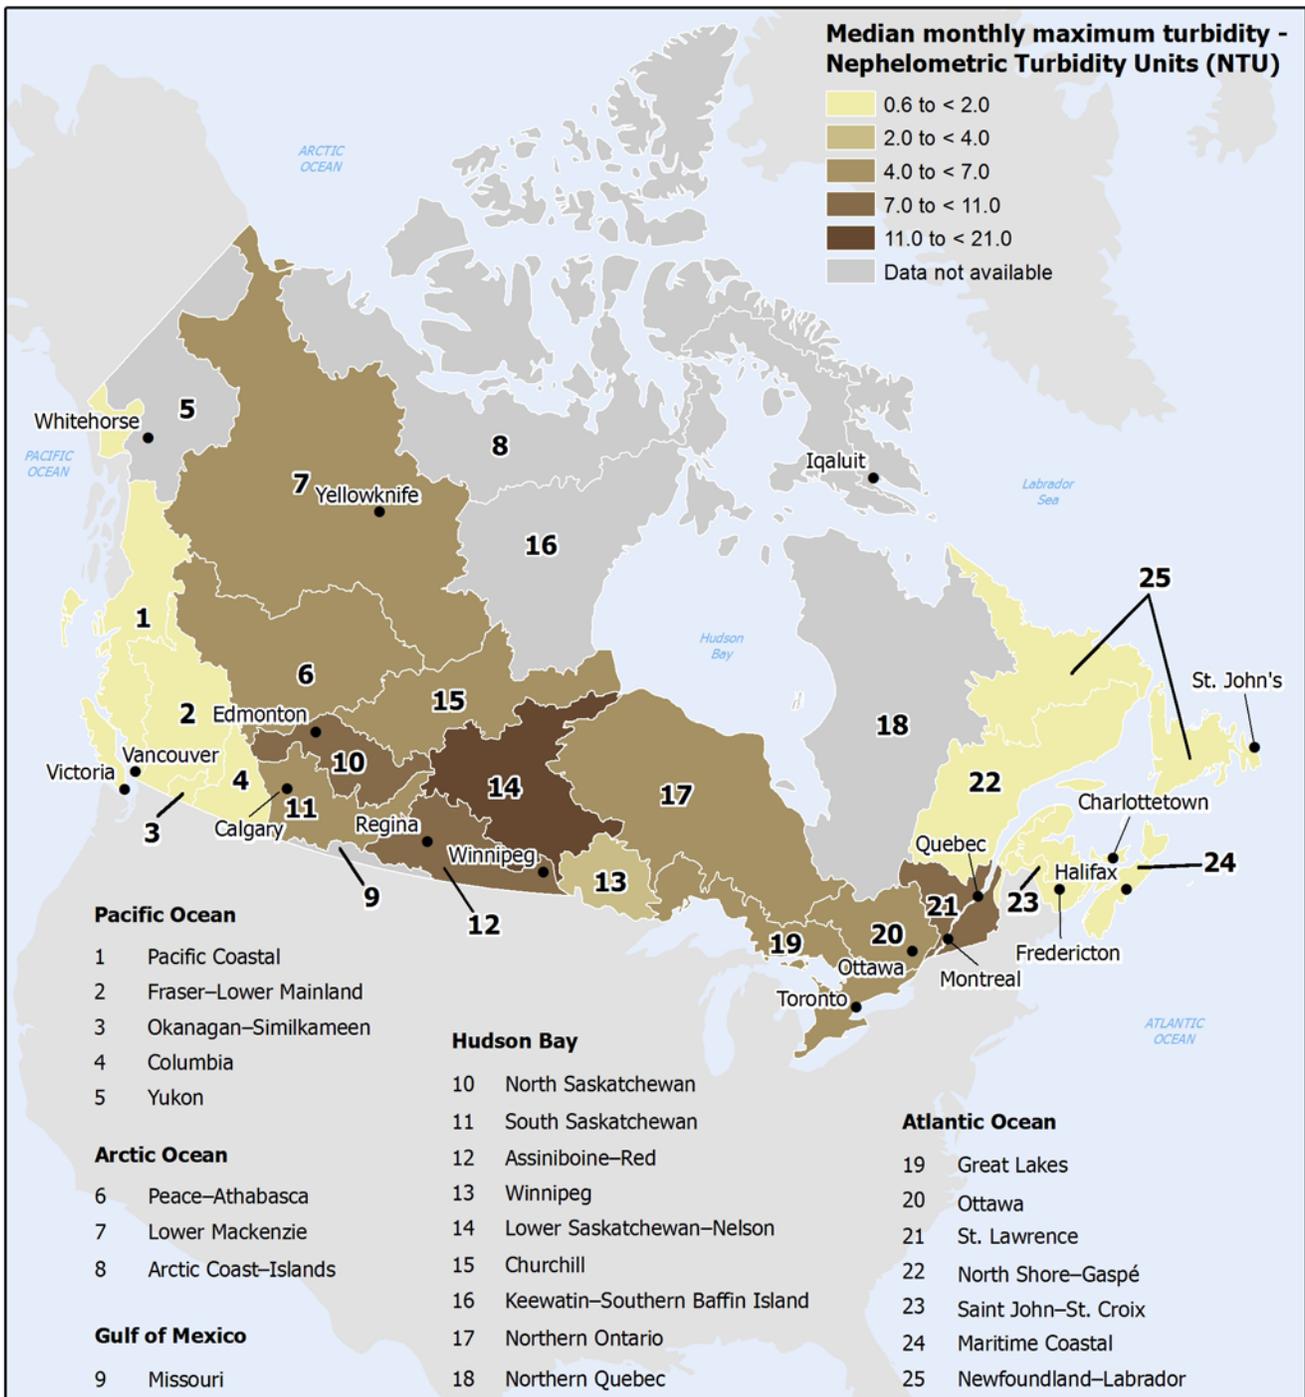

Notes: The data in Map 1 are raw surface water sources from facilities that reported turbidity data for at least 10 months in 2013. These facilities serving 24 million people produced 4,091 million cubic metres of potable water from surface water sources in 2013. Source water turbidity was monitored continuously at 42% of these drinking water plants in 2013, was monitored at least daily at 34% of plants and was less frequent at the rest.

Source: Statistics Canada, 2015, Environment, Energy and Transportation Statistics Division, Survey of Drinking Water Plants (survey number 5149).

Water quality data of surface water sources

The Survey of Drinking Water Plants collected data on several water quality parameters to provide information about the quality of source water used by drinking water plants in Canada. The data analysed are from plants using 90% or more surface water. The data represent source water quality in the environment before treatment and not final drinking water quality. Source water quality results presented in this report are based on reported data only. No editing or imputation was made to account for non-response. The results are based on the plants that reported data for the given parameter and apply only to the water processed and the population served by those plants. In some cases, there are no results for certain drainage regions due to low response for the given parameter in that area.

“Median maximum” refers to the median of all the maximum values reported for a particular source water quality parameter.

“Median average” refers to the median of all the average values reported for a particular source water quality parameter.

“Median minimum” refers to the median of all the minimum values reported for a particular source water quality parameter.

About the Survey of Drinking Water Plants

The Survey of Drinking Water Plants is a census of drinking water plants serving 300 or more people, and asks for information on volumes of water treated, type of treatment, financial aspects of the operation, as well as raw (source) water quality. The survey results produce a national portrait of treatment processes and costs, and source water quality across Canada. The survey compiles monthly source/raw water quality data for temperature, *Escherichia coli* and turbidity collected by treatment plant operations to establish how these parameters and the quality of the raw untreated surface water sources vary spatially and seasonally in Canada. This analysis of the survey data for 2011 and 2013 demonstrates how existing monitoring data from drinking water plant operations can be compiled to build a national database of source water quality for surface water sites across Canada.

The Survey of Drinking Water Plants is part of a suite of water surveys that collect data integrated into a water account to provide a national perspective on water use and contribute to the Canadian Environmental Sustainability Indicators (CESI). The survey utilizes information obtained from the network of water utilities to build water accounts that describe the quality of the stocks of water resources defined for a specific concern, in this case surface water sources for drinking water.

More information about the survey can be found at the following links:

<http://www.statcan.gc.ca/daily-quotidien/150619/dq150619d-eng.htm>

Definitions, data sources and methods: [survey number 5149](#)

For more information, or to enquire about the concepts, methods or data quality of this release, contact us (toll-free

1-800-263-1136; 514-283-8300; STATCAN.infostats-infostats.STATCAN@canada.ca) or Media Relations (613-951-4636; mediahotline@statcan.gc.ca).

Related topics: Canadian Nature Survey, Environment Canada. [<http://ec.gc.ca/Publications/default.asp?lang=En&xml=BF2EC39D-1124-42BA-85B2-52B24A13CFEA>]